

SCOPE OF WORK


AHU.	BY: Factory
CDU.	BY: Factory
HPU.	BY: Factory
Control Box (PLC)	BY: Factory
Starter Box AHU.	BY: Factory
Display Touch Screen	BY: Factory
DPS, DPT, Temp.	BY: Factory
T/Hu (Room)	BY: Factory
	BY: Factory, Cable Control

EXH.	BY: Installation Contractor
VSD	BY: Installation Contractor
—/—	BY: Installation Contractor Cable THW size 1x1sq.mm
—/—	BY: Installation Contractor Cable Control size 2x0.75sq.mm
—/—	BY: Installation Contractor Cable Control size 3x0.75sq.mm
—/—	BY: Installation Contractor Cable Control size 4x0.75sq.mm
—/—	BY: Installation Contractor Cable Control size 5x0.75sq.mm
—/—	BY: Installation Contractor Cable Control+Shield size 4x0.75sq.mm
—/—	BY: Installation Contractor Cable Control+Shield size 5x0.75sq.mm
—/—	BY: Installation Contractor สายลมวัดแรงดันตกคละผสม

ลงชื่อ *[Signature]* ประธานกรรมการ
 ลงชื่อ *[Signature]* กรรมการ
 ลงชื่อ *[Signature]* กรรมการ
 ลงชื่อ *[Signature]* กรรมการ
 ลงชื่อ *[Signature]* กรรมการ



CABLE CONTROL DIAGRAM (OPERATING ROOM)

ตำแหน่งติดตั้งโคมพานแอลไลท์แอลอีดี ห้องผ่าตัด

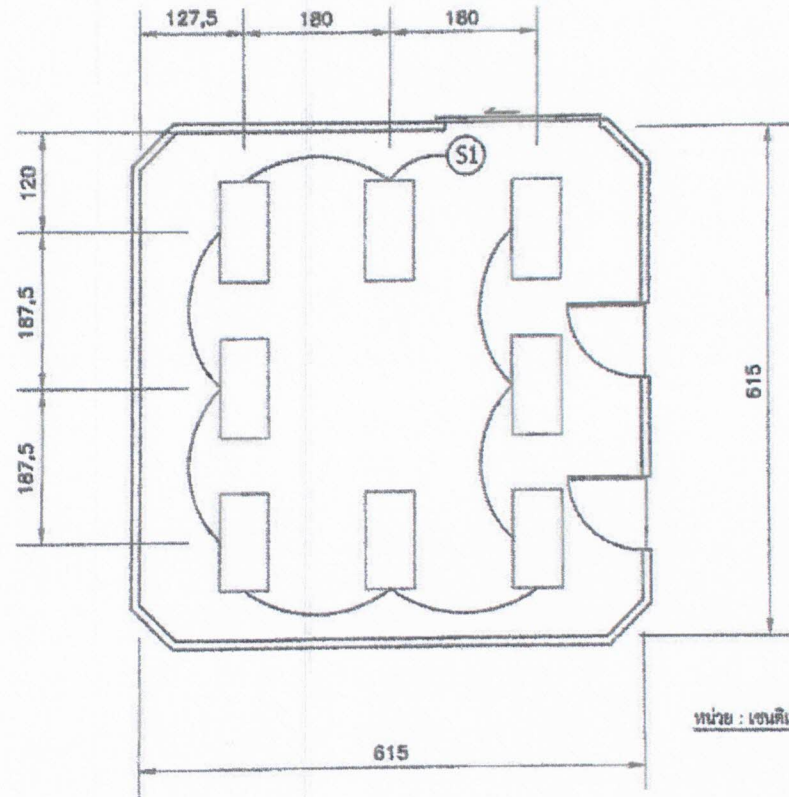

ลงชื่อ ประธานกรรมการ
 ลงชื่อ *or* กรรมการ
 ลงชื่อ *ชชาติ โหมทวิทย์* กรรมการ
 ลงชื่อ *mmk* กรรมการ
 ลงชื่อ *สมชาย วิชาญวงศ์* กรรมการ

แบบรูปปรับปรุงประตู หน้าต่าง ห้องผ่าตัด

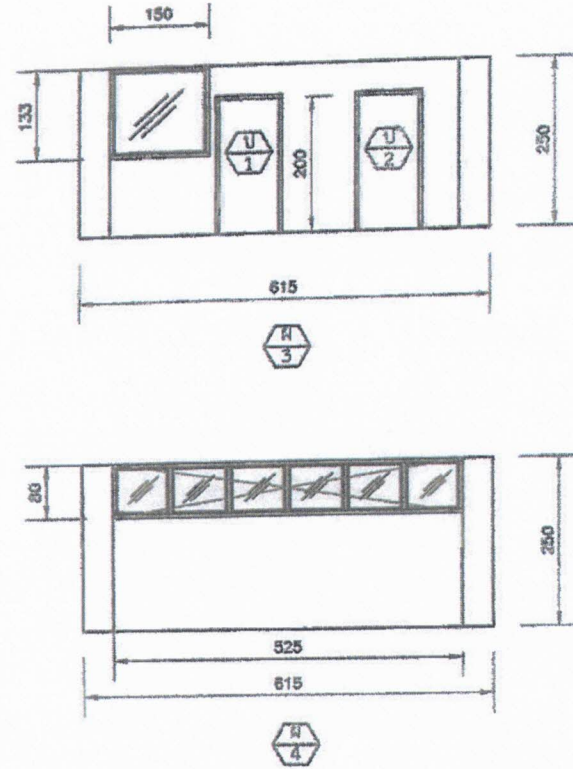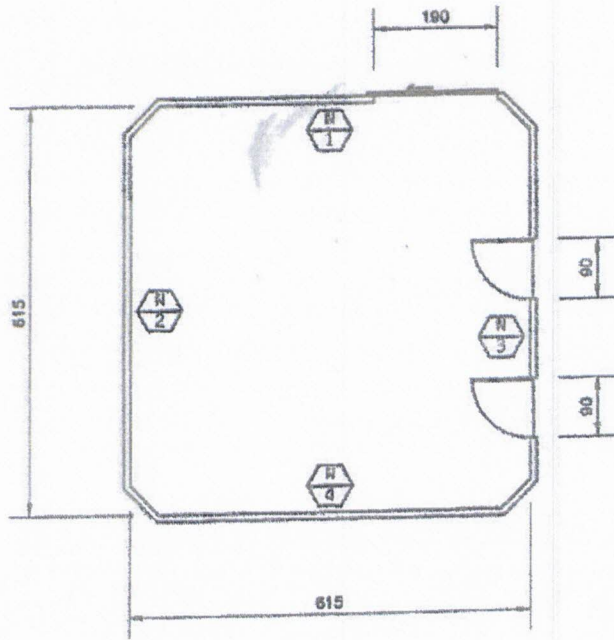

ลงชื่อ อลงกตประธานกรรมการ
 ลงชื่อ อนันต์กรรมการ
 ลงชื่อ รพีดล โททวิรัตน์กรรมการ
 ลงชื่อ มณเฑียรกรรมการ
 ลงชื่อ สุวิมลกรรมการ